




EDMI Mk 7C Electricity Meter



User Guide to LCD Screen Displays

Version 1.1

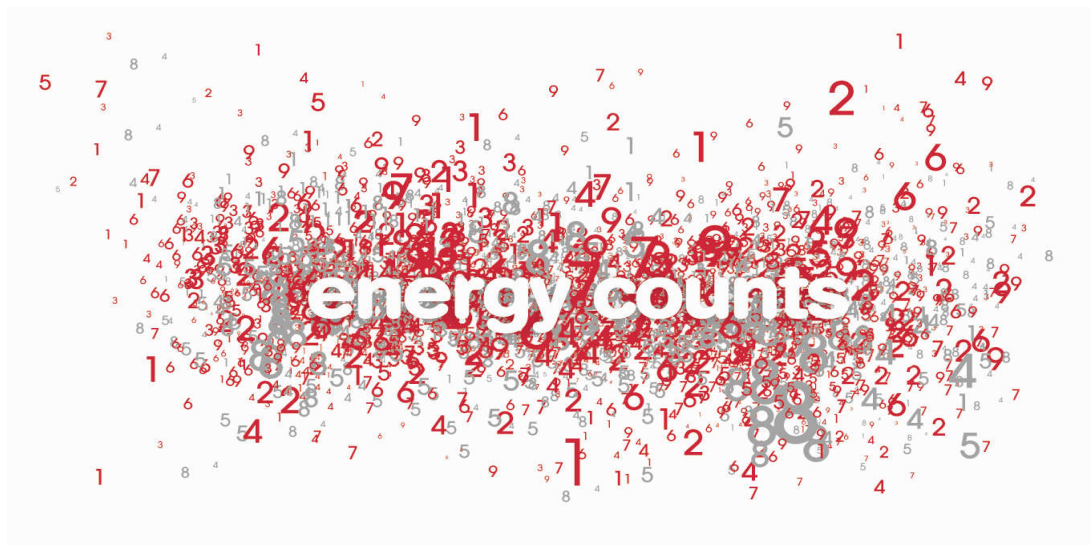

1.0 Introduction

The EDMI Mk 7C meter is a new development of 'Smart' metering used to measure Electricity consumption. It is a unique product which enables energy usage to be continually measured and stored and then data is transmitted to the electricity supply company when needed for billing. The meter has a large number of features, readily available, to provide Users with detailed information about their electricity supply including; Date, Time, Tariff (Standard Settlement Configuration - SSC), Total Billing Energy Consumption together with individual Rate consumptions for consumers on multi rate tariffs. In addition, Power Factor, Maximum Demand and billing reset information is available for Users who need this additional information.

There is an option to obtain analysed billing data information via a web link so that Users can see a detailed breakdown of their energy usage and time of use to enable any unplanned wastage to be eliminated and help manage more efficient usage, as part of an energy management process.

2.0 Access to Display Screens

Access to all the features of the meter only requires the pushing of a single 'select' button on the meter. The meter has two main displays called '**Set A**' and '**Set B**'.


Set A contains the main User displays whilst **Set B** contains test/supplementary information.

To move from '**Set A**' to '**Set B**' you simply press and hold the 'display' button for approximately 2 seconds.

- The meter itself is normally set to automatically cycle through the 'Set A' LCD displays to show individual items approximately every 10 seconds.
- You can force it to go to the display item you want within the 'Set' by simply pressing the 'select' button once and the display will advance one step. Continual individual presses of the button will eventually cycle the display back to your starting point.

Details of all the individual LCD screens within each 'Set' are shown on the following pages.


3.0 The Display with all segments illuminated

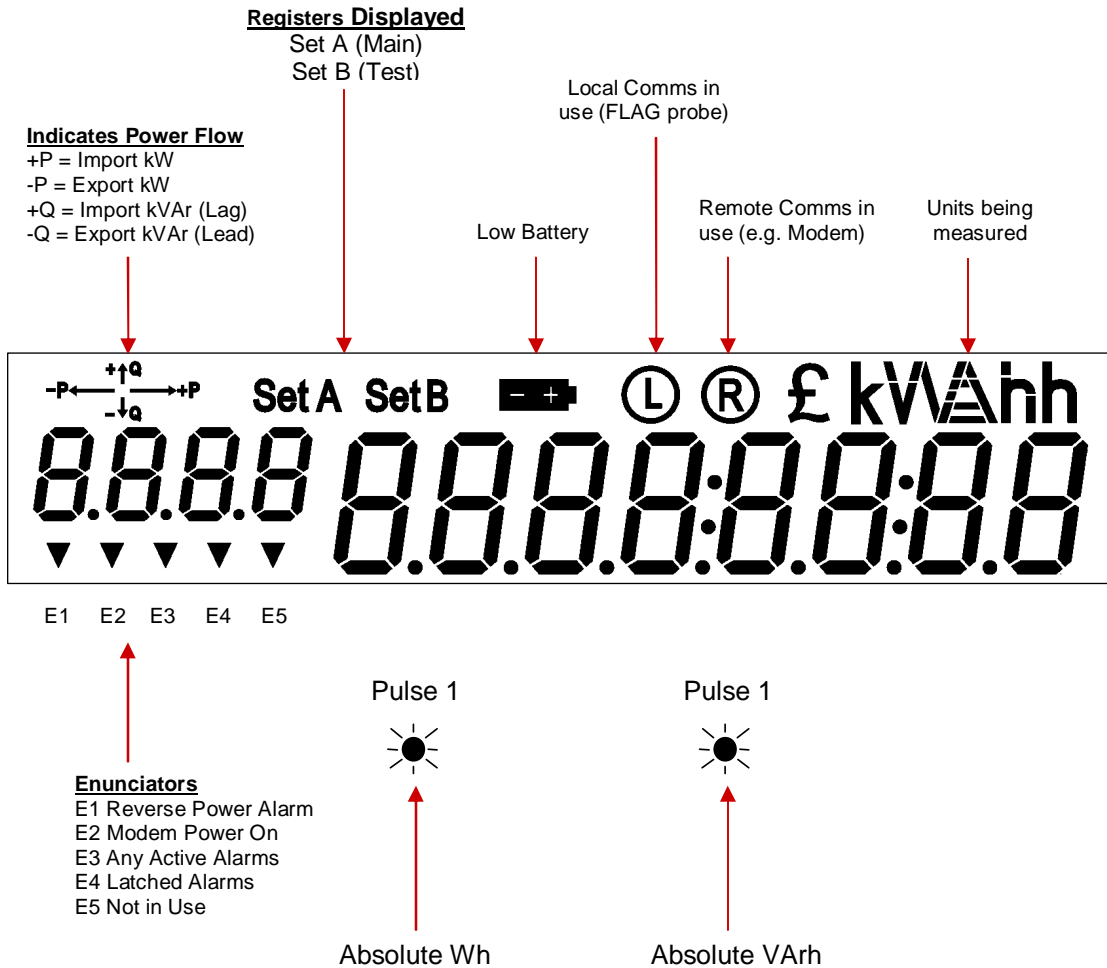

3.1 Set A - Meter Reading Information

Please note that the displays will normally cycle around each item in turn automatically every 10 seconds.

Current Time (GMT)

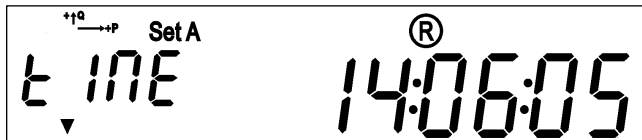

Current Date
(26th May 2009 Shown)



3.1 Set A - Meter Reading Information

Register Identifiers
(for billing purposes)

Rate 1
(Meter Reading)



R1,
R2,

Please note that for multi-tariff meters the meter registers will follow in sequence after r1.

Total kWh
(Meter Reading)



S

Please note for single rate tariff meters the total register will be the only one displayed.


kVArh Lag
(Sine Meter Reading)



KV

Please note that for Users on non-MD tariffs some of the display registers shown are not applicable to your tariff and will therefore not be displayed.

kVAh
(Apparent Energy Meter Reading)

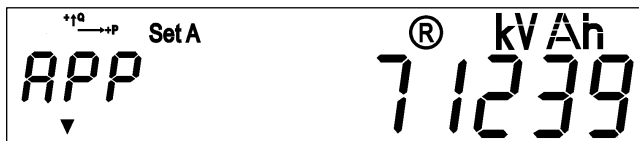

KZ

Maximum Demand in kW
(Highest Demand since last reset)




MD

Maximum Demand in kVA
(Highest Demand since last reset)



MZ

Previous MD in kW

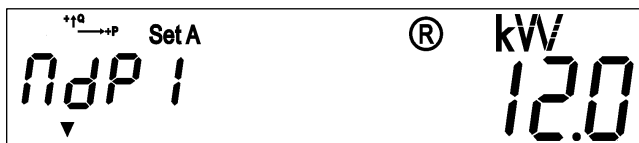

3.1 Set A - Meter Reading Information cont...


Previous MD in kVA



Billing Reset
(Count of resets)




Billing Reset
(Date)

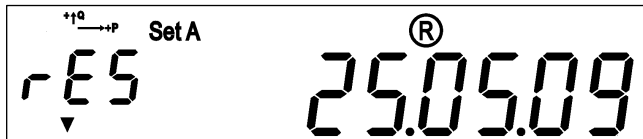

Billing Reset
(Time)




Tariff and Meter Serial Number
(e.g. SSC 0244 & E07BG04061)

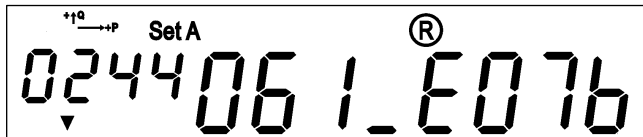


Indicates the start of the Meter Serial Number which scrolls across the LCD

MPAN
(e.g. 1600000000283)

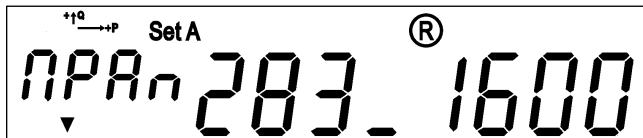

Indicates the start of the MPAN which scrolls across the LCD

Test Display
(All segments illuminated)

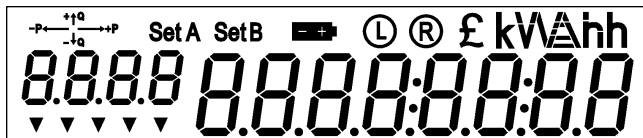

This is the last display in 'Set A' before reverting back to the first display: Current Time


3.3 Set B – Test/Supplementary Information

Set B shown when 'select' button is held for 2 seconds

Signal Strength



Alarm Status Flags

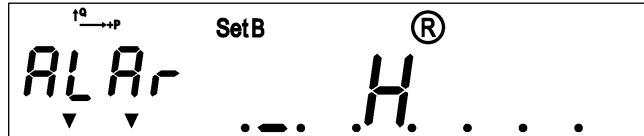


Flag Letter	Alarm Name
E	Analogue Reference Failure
V	Voltage Tolerance Error
C	Clock Failure
M	Reverse Power
L	Calibration Data Lost
H	Modem Failure
X	Ram Failure or LCD Failure
Y	Program Flash Failure
Z	Data Flash Failure
N	Pulsing Output Overflow
D	Battery Failure
U	Tamper

Indicates the start of the Alarm Codes which scroll across the LCD


Current

(Phase Current RMS)

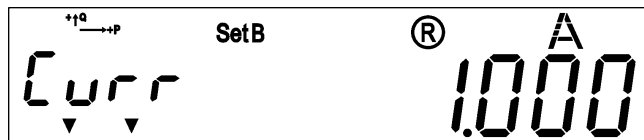


Voltage

(Phase Voltage RMS)

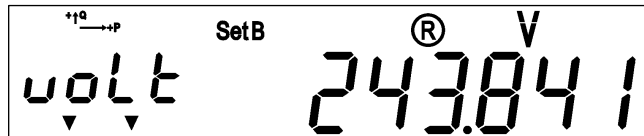


Power Factor (PF)

(-ve for Lag, +ve for Lead)

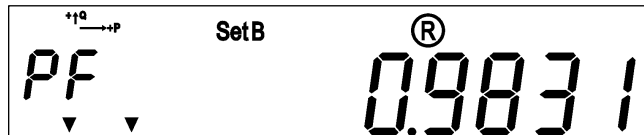


3.3 Set B – Supplementary Information cont...


Total Active Power kW
(+P for import, -P for export)

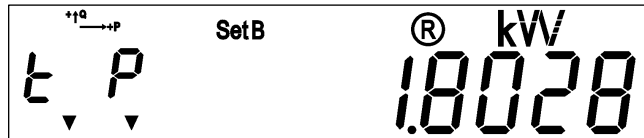

Total Reactive Power kVAr
(+Q for import, -Q for export)

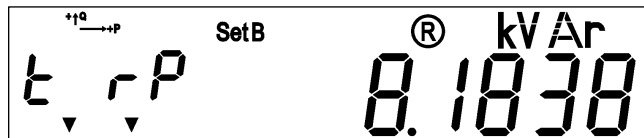

Total Apparent Power kVA
(+P for import, -P for export)

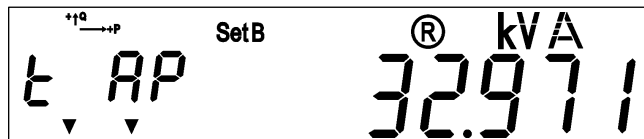

Manufacturers Serial Number



This is the last display in 'Set B'. The meter should automatically revert to 'Set A' after approx 45 seconds if no further keys are pressed. Alternatively you can force it back to 'Set A' by pressing the 'select' button for 2 seconds.



FOR MORE INFORMATION CONTACT

Bglobal Metering Limited
Arkwright House,
2 Arkwright Court
Commercial Road
Darwen
Lancashire
BB3 0FG

Tel. +44 (0)1254 819600
Email info@bglobalmetering.com
Web www.bglobalmetering.com

Bglobal Metering Limited Registered Office: Arkwright House, 2 Arkwright Court,
Commercial Road, Darwen, Lancashire BB3 0FG
Registered No 04945062 VAT No 904 4503 52